



SBEC (SE2) UNDERGROUND SERVICE INSTALLATION FROM POLE MOUNTED TRANSFORMER

NOTES:

1. MEMBER TO INSTALL METER BASE, MAIN DISCONNECT, GROUND ROD, CONDUIT AND WIRING. SBEC PERSONAL NEED TO BE ON SITE TO INSTALL CONDUIT ON POLE AND MAKE FINAL CONNECTION ON TRANSFORMER POLE.
2. CONDUIT SHALL BE MINIMUM SCHEDULE 40 RIGID PVC NONMETALLIC CONDUIT BELOW GRADE AND GALVANIZED RIGID METAL OR SCHEDULE 80 RIGID PVC NONMETALLIC CONDUIT ABOVE GRADE.
3. ALL CONDUIT SHALL BE INSTALLED WITH MARKINGS POSITIONED SO THEY ARE VISIABLE FOR INSPECTION.
4. ALL JOINTS MUST BE PROPERLY GLUED.
5. WEATHERPROOF FITTINGS ARE REQUIRED.
6. TRENCH SHALL REMAIN OPEN UNTIL INSPECTION IS MADE BY AN SBEC REPRESENTATIVE.
7. METER LOOP SHALL REMAIN UNENCLOSED ON THE EXTERIOR WALL.
8. EXTERIOR DISCONNECTED REQUIRED ACCORDING TO NEC 230.85 OR LATEST REVISION THERE OF.
- * EXTERIOR MAIN BREAKER PANEL IS REQUIRED OR A EMERGENCY DISCONNECT SWITCH IF MAIN BREAKER IS LOCATED INSIDE ADJACENT TO METER LOCATION.
9. GROUND WIRE MUST BE SIZED ACCORDING TO NEC TABLE 250.66 OR LATEST REVISION THERE OF AND RUN FROM NEUTRAL TO GROUND ROD.
10. MAXIMUM LINEAL DISTANCE OF THE TRENCH SHALL BE NO GREATER THAN 125 FT. FOR 200 AMP SERVICE OR LESS.
11. MAXIMUM LINEAL DISTANCE OF THE TRENCH FOR SERVICES LARGER THAN 200 AMP SHALL BE DETERMINED BY AN SBEC REPRESENTATIVE.

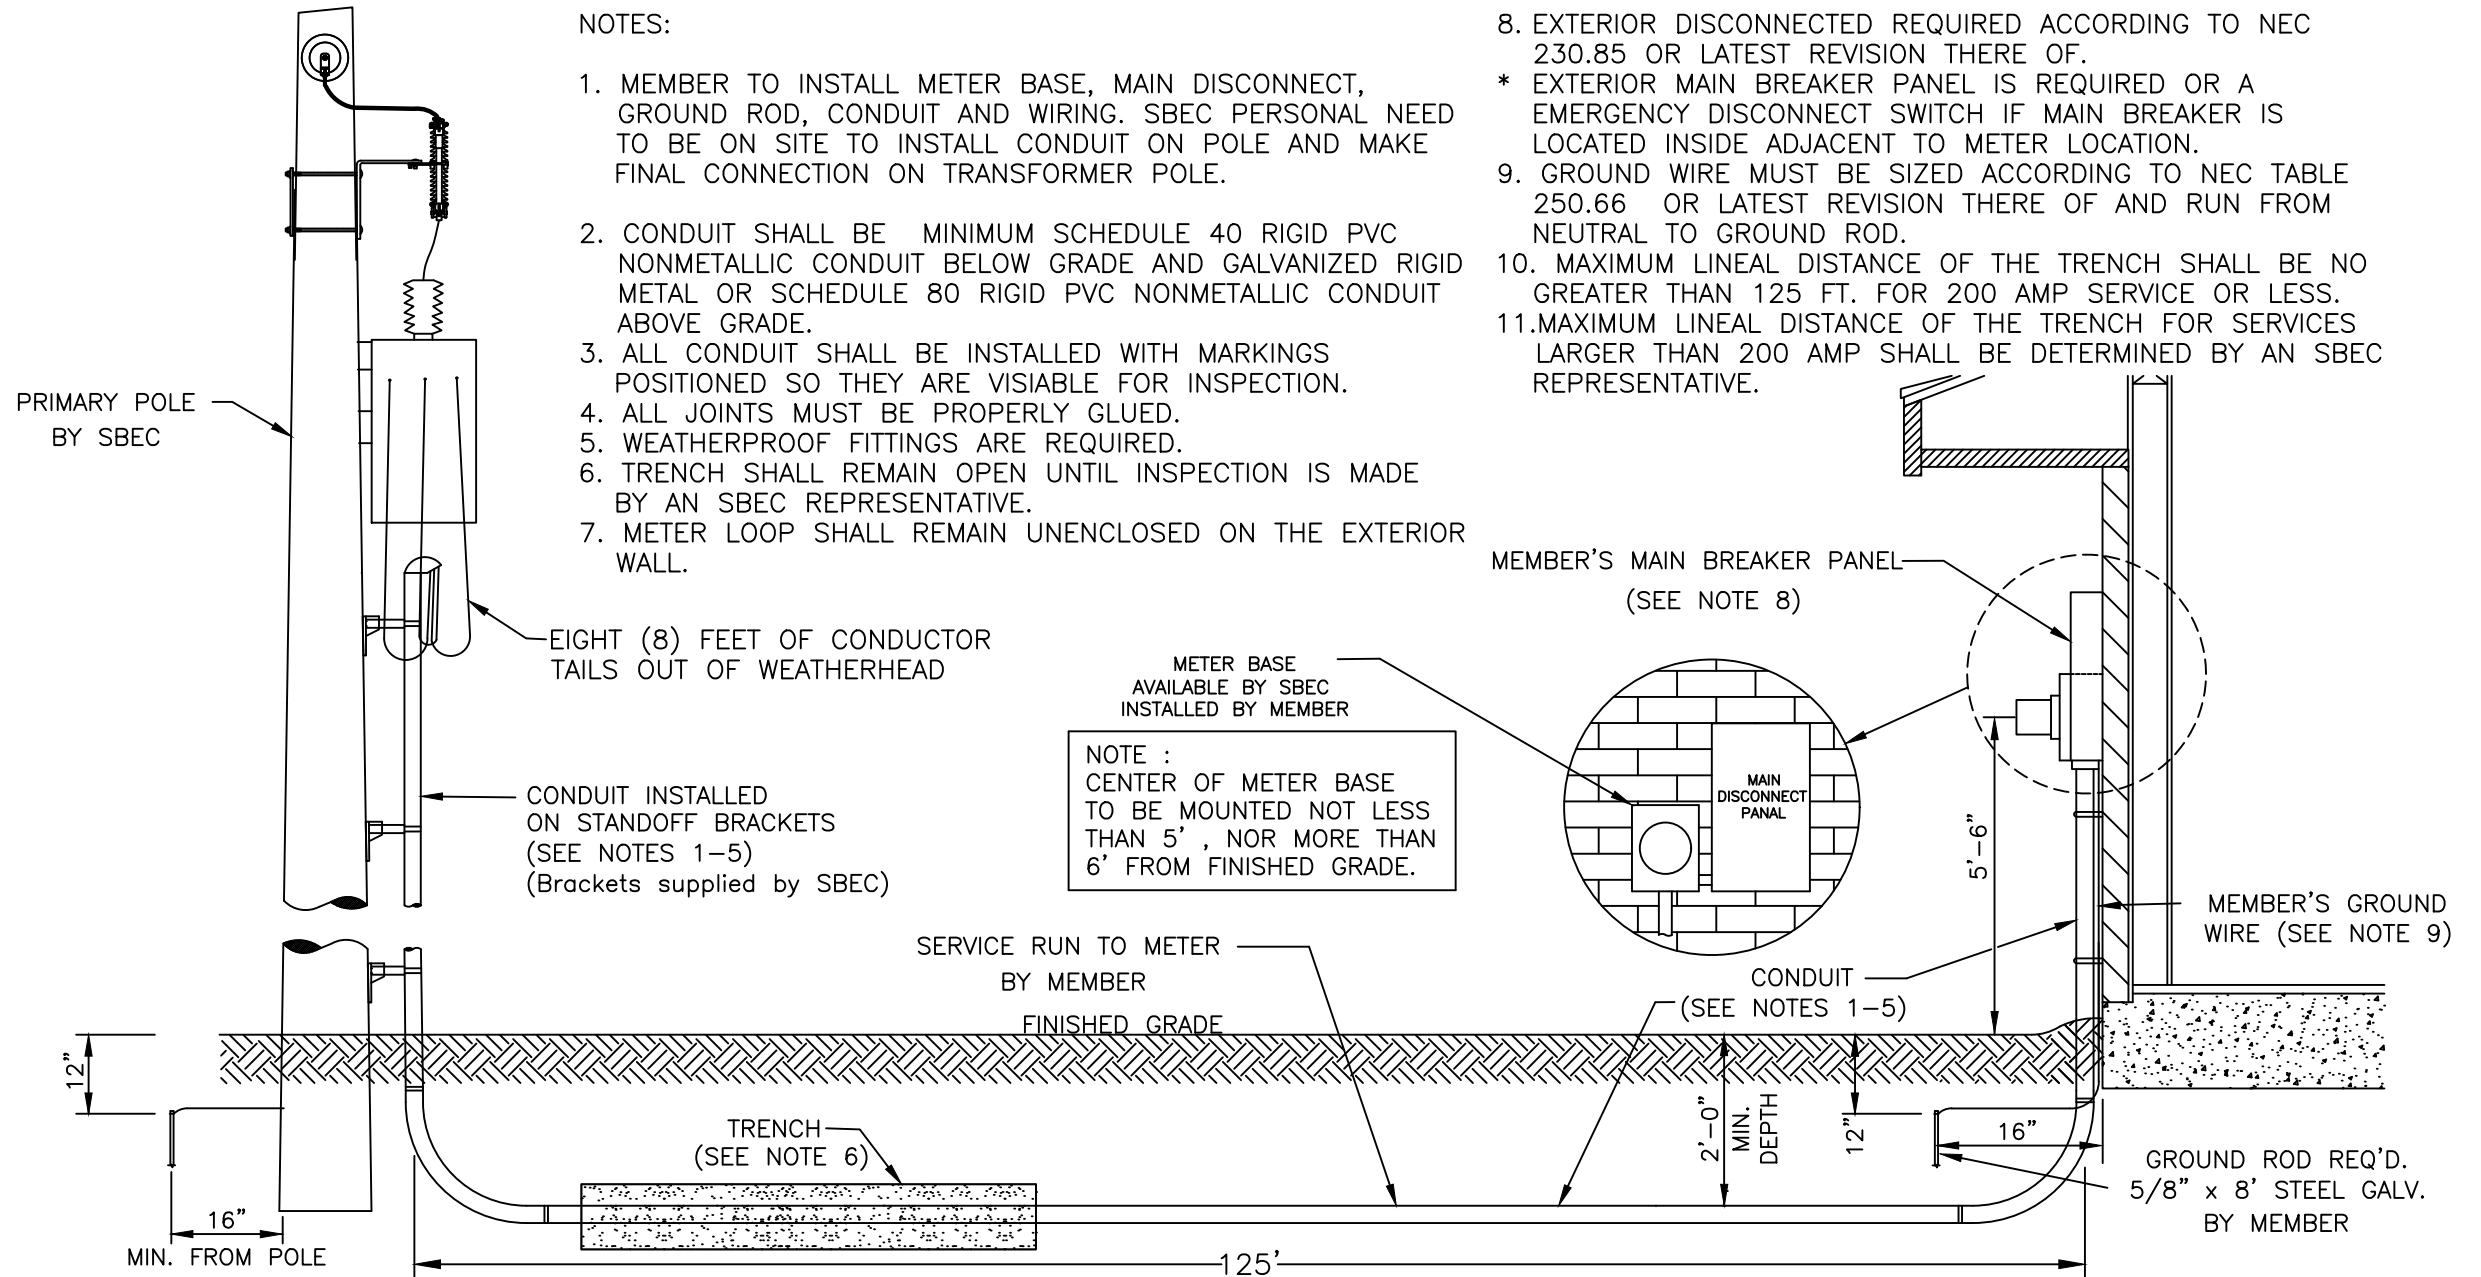

NOTE :
 CENTER OF METER BASE
 TO BE MOUNTED NOT LESS
 THAN 5' , NOR MORE THAN
 6' FROM FINISHED GRADE.

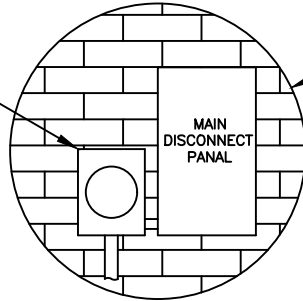

GROUND ROD REQ'D.
 5/8" x 8' STEEL GALV.
 BY MEMBER